


# NO PARKING FIRE LANE SIGN DETAIL

## COMMERCIAL & RESIDENTIAL APPLICATION

Sign is .080 inch aluminum with red letters, symbols and frame on a highly reflective white background.  
 Sign is a variant consistent with the standard of the MUTCD code R7-107 of Section 28.34 for conventional roads per the DOT standard highway signs.

Sign graphic to be consistent with any of the graphics on this sheet.  
 Sign is 18 inches high and 12 inches wide and is mounted so the bottom of the sign is at 7 feet high. It may be angled toward oncoming traffic.  
 Sign spacing for public or private streets and shared driveways shall be at intervals not exceeding 150 feet between signs on each side of the street.  
 Sign spacing for on-site lot vehicle circulation shall be at intervals not exceeding 75 feet between signs.

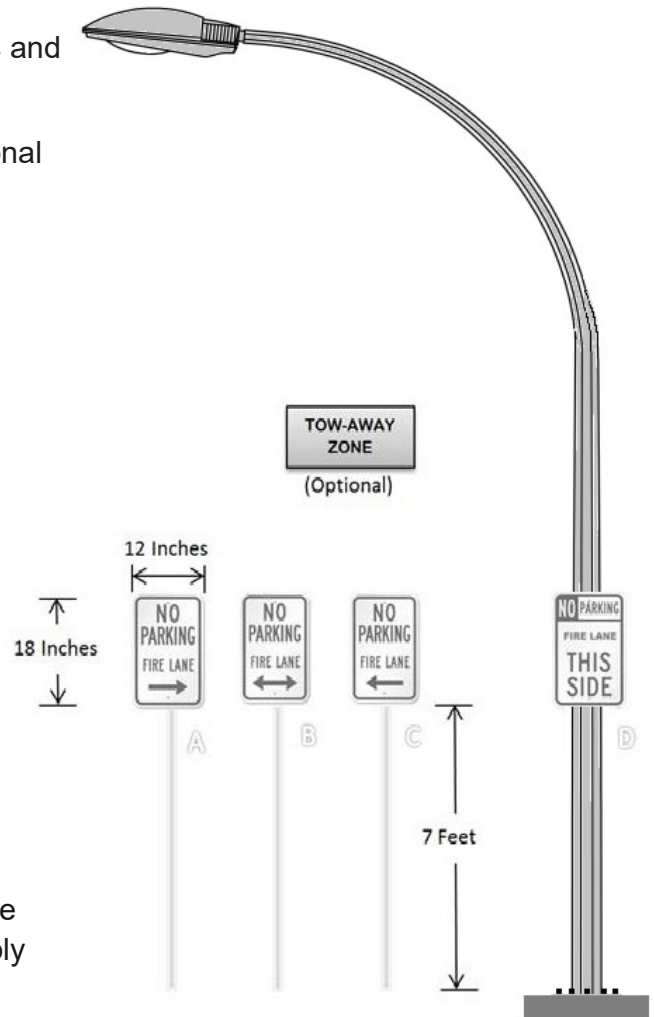

- Lanes less than 28 feet wide – signs mounted on both sides of lane
- Lanes wider than 28 feet but less than 36 feet wide – signs mounted on one side of the lane (preferably the same side of the lane as the fire hydrants)
- Lanes 36 feet wide or more - signs not required by the Fire Department
- Cul-de-sacs less than 43' in paved radius – signs mounted around the entire circumference of the cul-de-sac
- Hammer-heads and other turn-around provisions required for fire apparatus – signs shall be mounted on each side of all lanes within the turn-around

Placement standards: NO PARKING FIRE LANE shall be posted wherever parking could obstruct the required minimum 20 foot wide, or wider, fire apparatus access lane.

Where approved fire lane signs are installed, fire lane curb paint shall not additionally be required.



E



Vancouver Municipal Code Title 16 adopting the International Fire Code including section 503



F

### VANCOUVER FIRE MARSHAL'S OFFICE

Fire Marshal: Heidi Scarpelli  
 Date: 04/15/2015



### NO PARKING FIRE SIGN CURB DETAILS

STANDARD PLAN NUMBER

## F503-B